

Drawing No:
0327

States Nursery Warwick Farm, St Helier

Boundary Information Supplied by the States of Jersey Planning Office, but no responsibility can be accepted for error.



**COPYRIGHT
STATES OF
JERSEY**

DWG NO.
TD WARWICK FARM


DEPARTMENT FOR
INFRASTRUCTURE, STATES OF
JERSEY COPYRIGHT.

INFORMATION HAS BEEN
PROVIDED FROM DATA
CURRENTLY AVAILABLE AND IS
THEREFORE NOT NECESSARILY
COMPREHENSIVE.

ALL DEVELOPMENTS MUST BE IN
COMPLIANCE WITH DRAINAGE
(JERSEY) LAW, 2005.

DRAINAGE (JERSEY) LAW, 2005
ARTICLE 17(1)(b) STIPULATES
THAT NO NEW CABLE, CONDUIT
MAIN OR PIPE SHALL BE
CONSTRUCTED WITHIN ONE
METRE OF A PUBLIC SEWER OR
OUTFALL.

© STATES OF JERSEY 2016.
DO NOT SCALE OFF DRAWING.

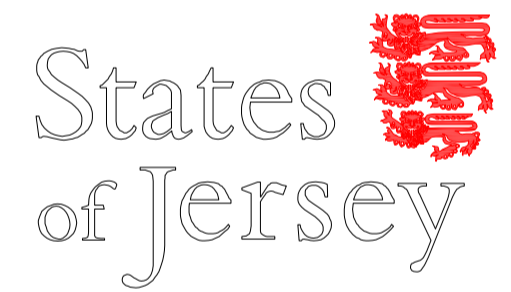

DEPARTMENT FOR
INFRASTRUCTURE

P.O. BOX 412
BERESFORD HOUSE
BELLOZANNE ROAD
ST HELIER
JERSEY
JE4 8UY

TEL: 01534 445509

DWG TITLE
TANKER DISCHARGE
REQUIREMENTS
WARWICK FARM
STA HELIER

DRAWN BY
DfI RECORDS

DATE
05/05/2017

SCALE
1:200


SHEET SIZE
A1

DWG NO.
TD WARWICK FARM

SHEET NO.
1 of 1

REVISION
A

FILE PATH: I:\RECORDS\DRAWINGS\RECORDDW\Island Sewers\North.dwg

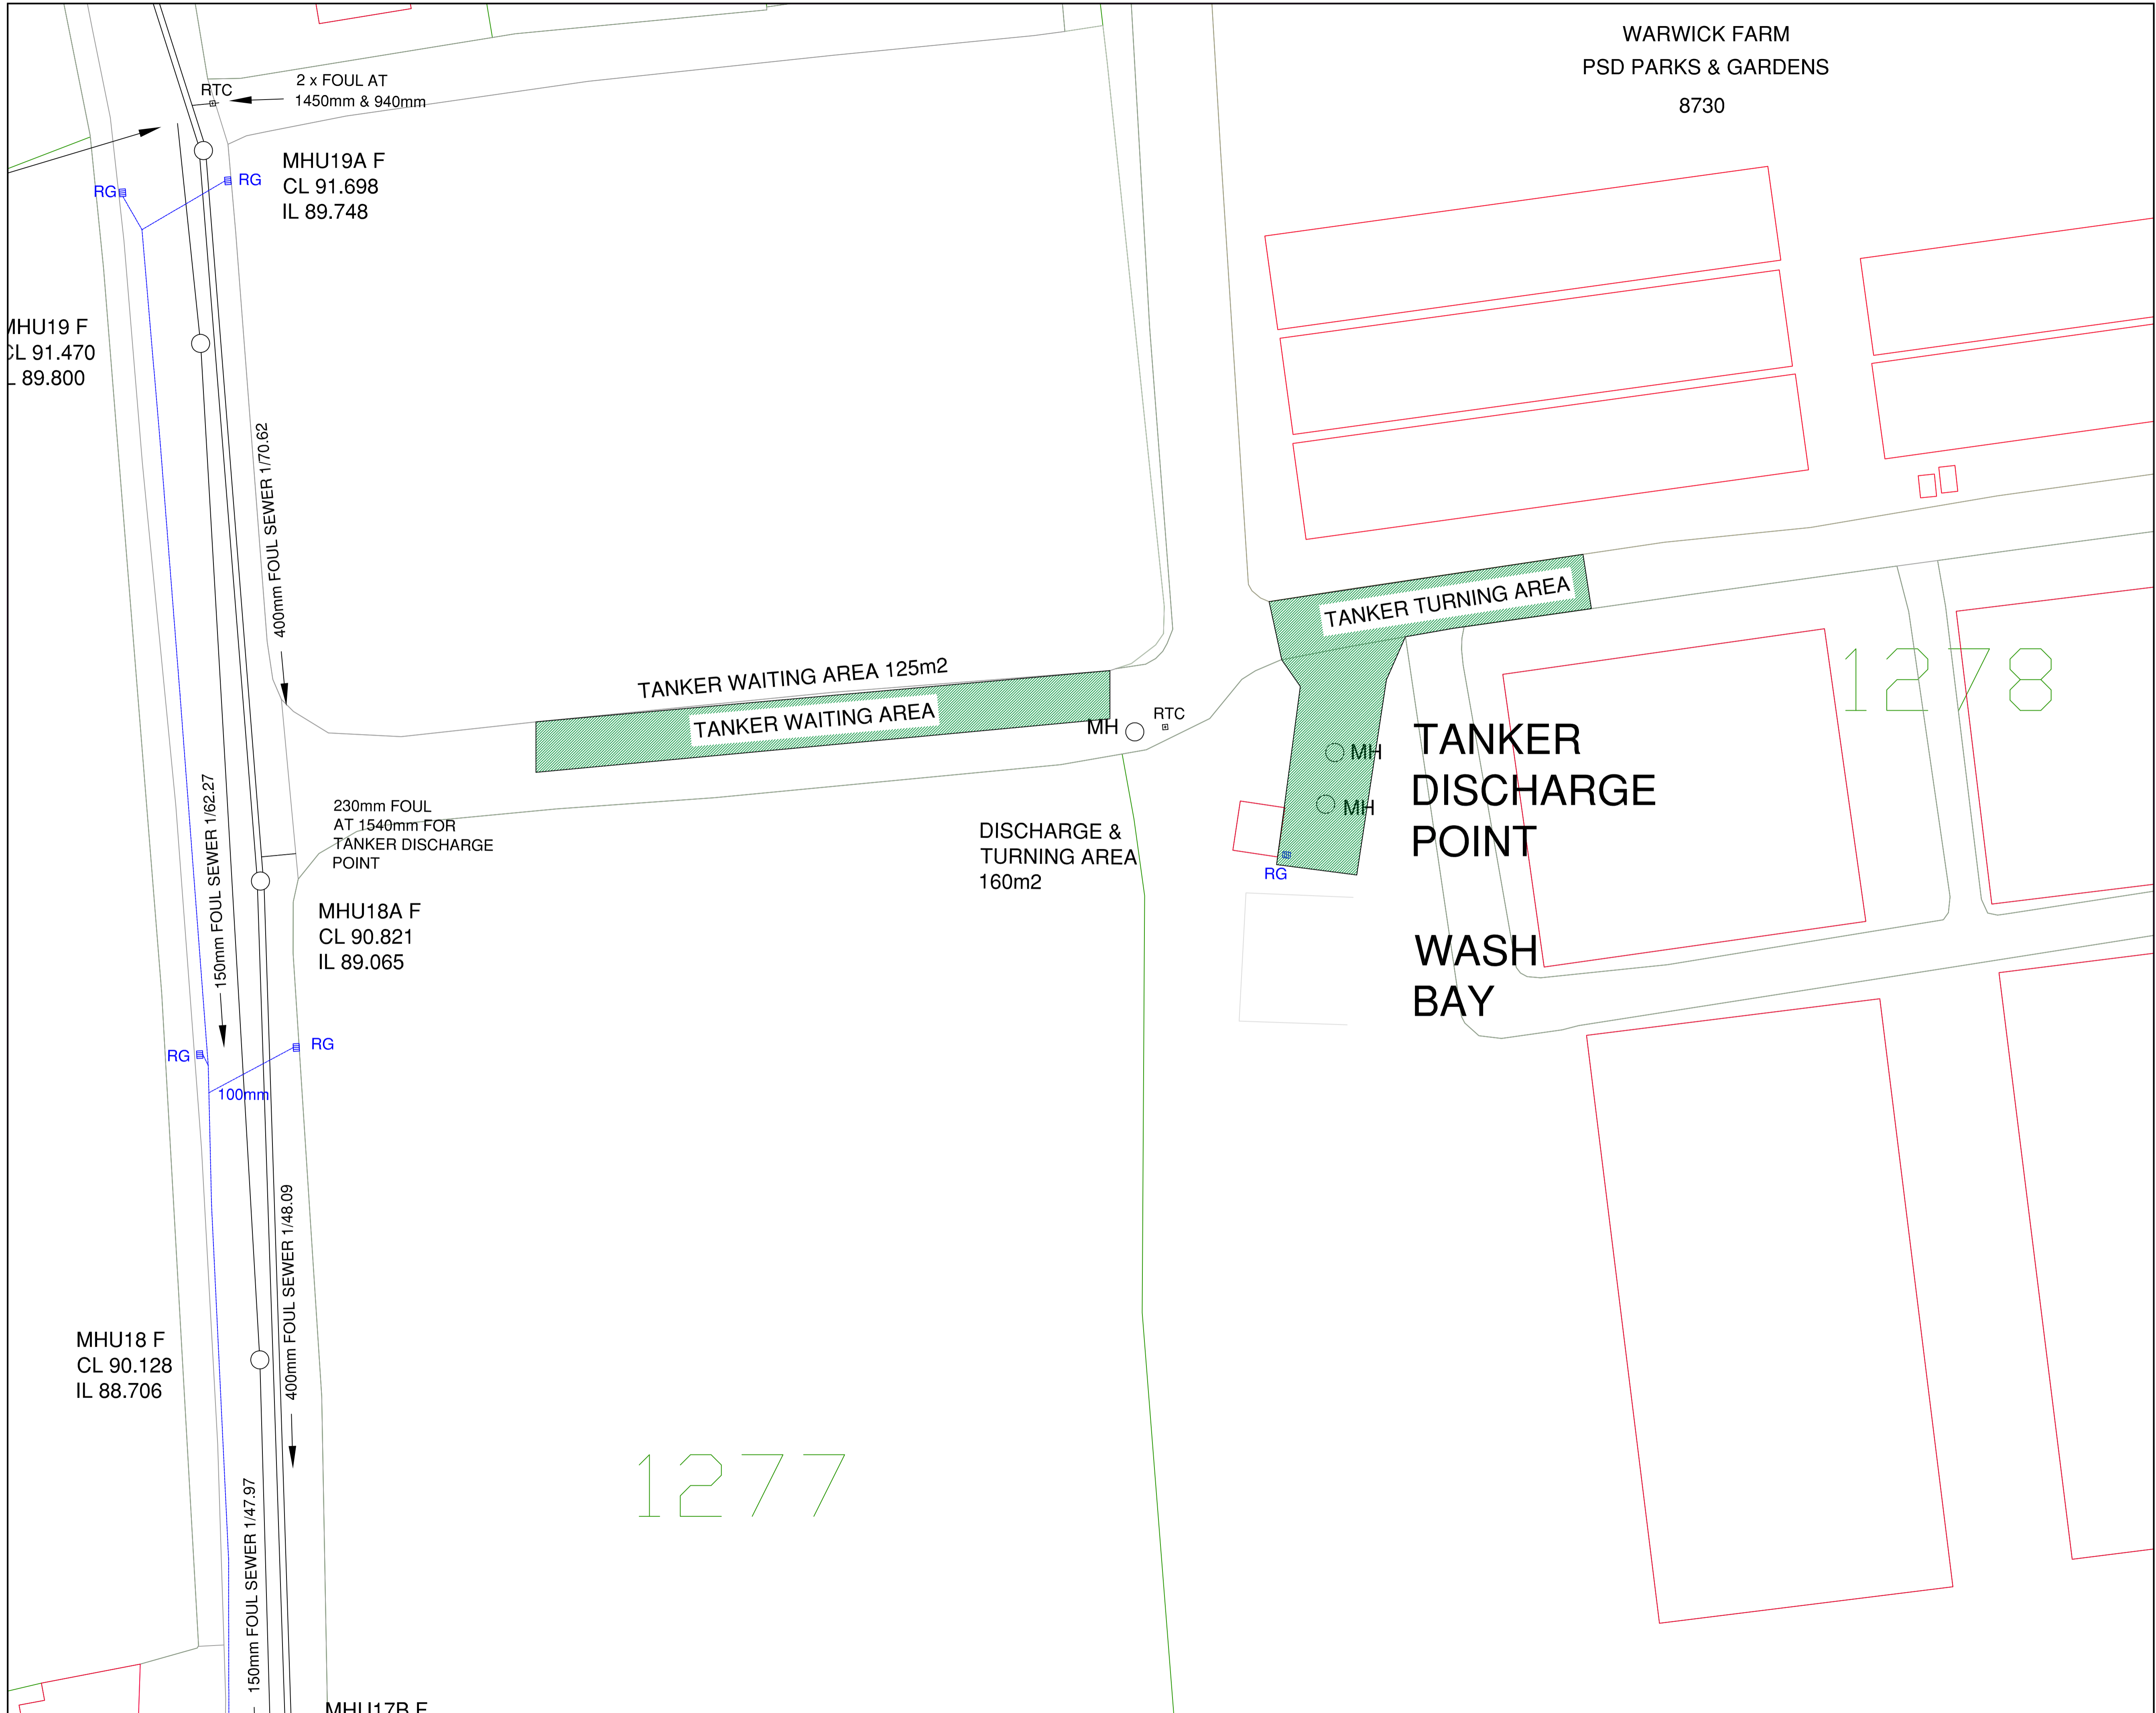

1277

1278

WARWICK FARM
PSD PARKS & GARDENS
8730

TANKER TURNING AREA

TANKER WAITING AREA 125m2
TANKER WAITING AREA

DISCHARGE &
TURNING AREA
160m2

TANKER
DISCHARGE
POINT

WASH
BAY

MHU19A F
CL 91.698
IL 89.748

MHU19 F
CL 91.470
IL 89.800

MHU18A F
CL 90.821
IL 89.065

MHU18 F
CL 90.128
IL 88.706

MHU17B F

2 x FOUL AT
1450mm & 940mm

230mm FOUL
AT 1540mm FOR
TANKER DISCHARGE
POINT

150mm FOUL SEWER 1/62.27

400mm FOUL SEWER 1/70.62

400mm FOUL SEWER 1/48.09

150mm FOUL SEWER 1/47.97

RG

RG

RG

RG

100mm

MH

RTC

MH

MH

RG